


INSTRUCTION SHEET

DCS-1 POWER SUPPLY

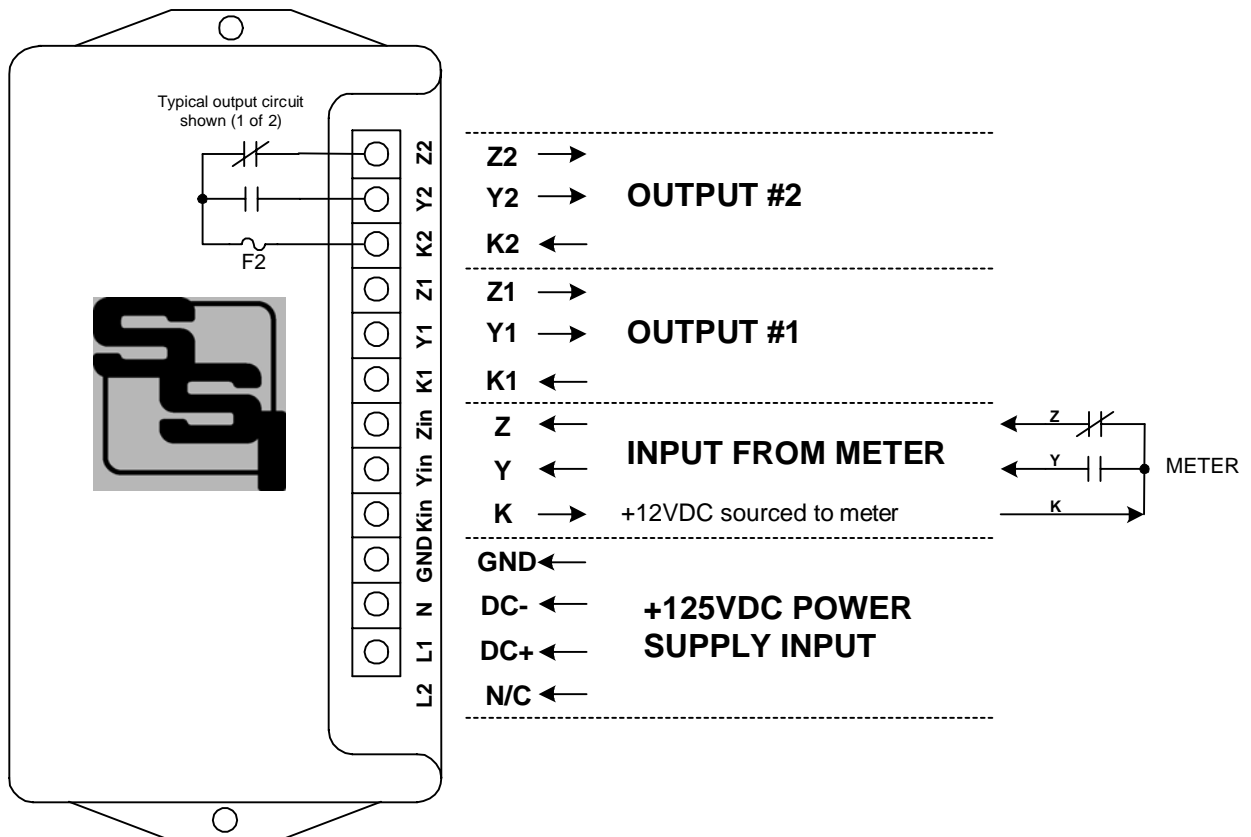

SUMMARY - This addendum accompanies any SSI Pulse Isolation Relay is equipped with the DCS-1 Power Supply option. This option allows you to power your relay from a +125VDC voltage source.

POWER INPUT - Connect the positive lead (+) of the 125VDC supply to the **L1** terminal. Connect the negative (-) lead to the **N** terminal. Connect the **GND** terminal to electrical system ground. If the negative of the power supply is the same as the electrical system ground, terminals **N** and **GND** can be tied together and be tied to ground.

METER CONNECTIONS - See your Pulse Isolation Relay's installation instruction sheet for the specific features and instructions for your relay.



SOLID STATE INSTRUMENTS

a division of Brayden Automation Corp.
6230 Aviation Circle, Loveland, Colorado 80538
Phone: (970)461-9600 Fax: (970)461-9605
E-mail: support@solidstateinstruments.com