


# INSTRUCTION SHEET


## DCS-2 POWER SUPPLY

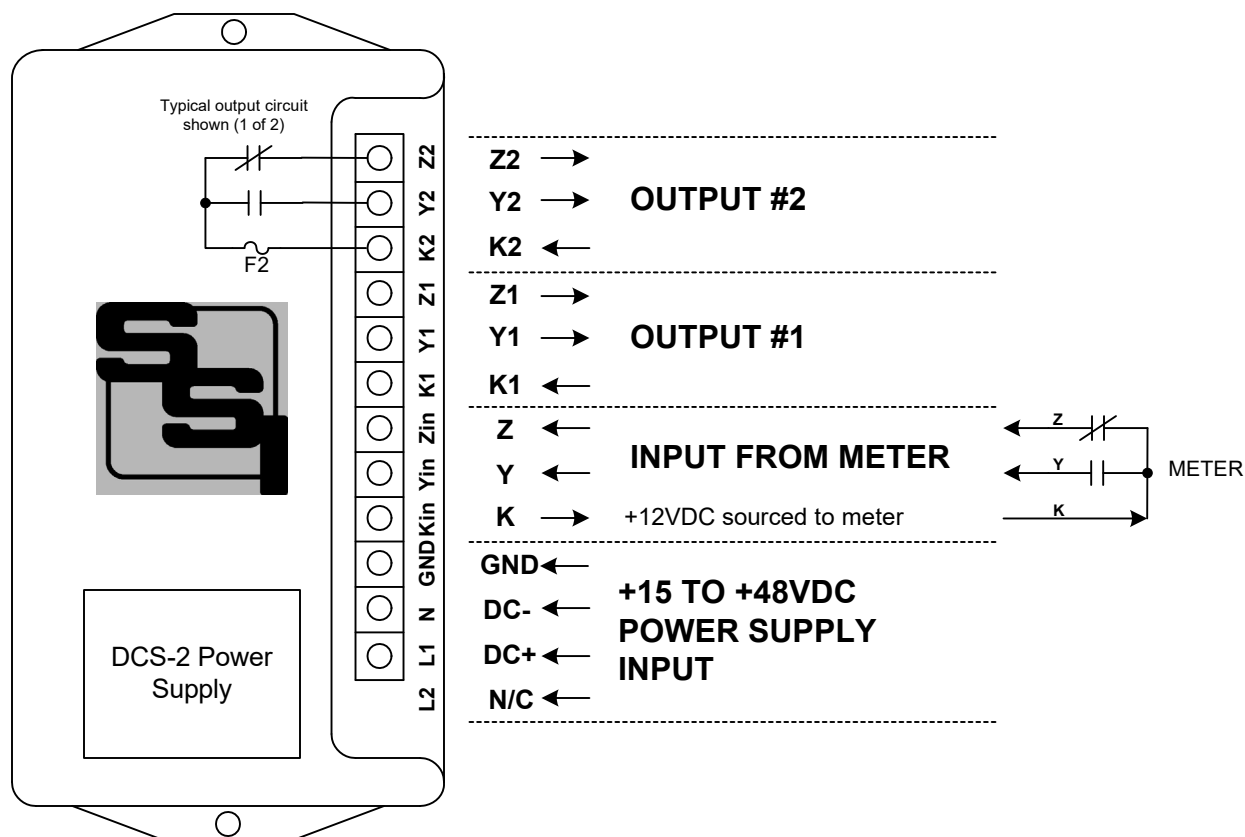

**SUMMARY** - This addendum accompanies any SSI Pulse Isolation Relay that is equipped with the DCS-2 Power Supply option. This option allows you to power your relay from a +DC voltage source over a range of +15 to +48VDC.

**POWER INPUT** - Connect the positive lead (+) of the DC supply to the **L1** terminal, up to +48VDC. Connect the negative (-) lead to the **N** terminal. Connect the **GND** terminal to electrical system ground. If the negative of the power supply is the same as the electrical system ground, terminals **N** and **GND** can be tied together and be tied to ground.

**METER CONNECTIONS** - See your Pulse Isolation Relay's installation instruction sheet for the specific features and instructions for your relay.



## SOLID STATE INSTRUMENTS

by Radian Research, Inc  
3852 Fortune Dr, Lafayette, IN 47905  
Phone: (765) 449-5576

Mail: [technicalsupport@radianresearch.com](mailto:technicalsupport@radianresearch.com)