

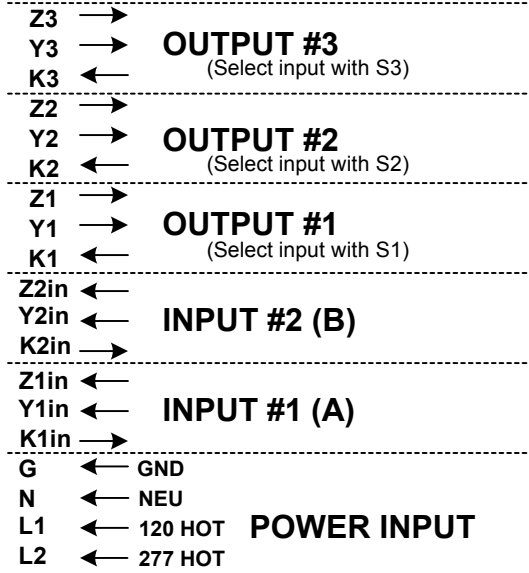


RPR-23PS

Elite Solid State

PULSE ISOLATION RELAY INSTRUCTION SHEET

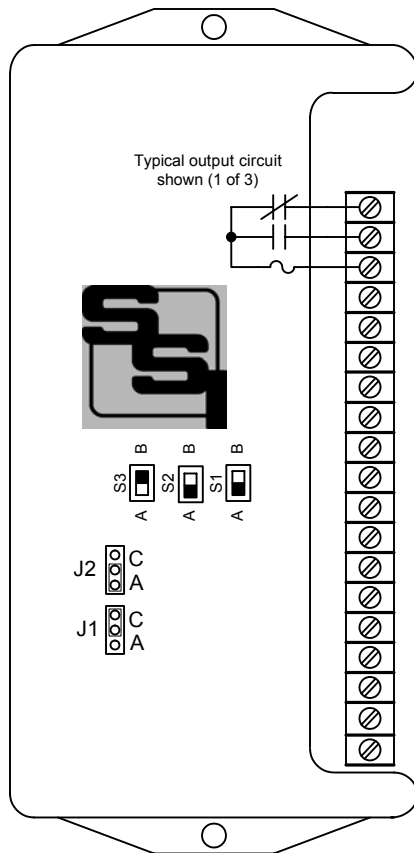

MOUNTING POSITION - The RPR-23PS may be mounted in any position.

POWER INPUT - For a power supply of 120VAC, connect the AC line's "hot" wire to the **L1** terminal. For 208 thru 277VAC, connect the AC line's "hot" wire to the **L2** terminal. The AC line's "neutral" wire should be connected to the **N** terminal. Connect the **G** terminal to the electrical system ground.

INPUT CONNECTIONS - Connect the K terminal of each meter which is supplying pulses to the RPR-23PS to the RPR-23PS' **K1in** and **K2in** terminals. Connect the each meter's Y and Z terminals to the respective meter's **Yin** and **Zin** input terminals of the RPR-23PS.

INPUT TYPE SELECTION - The RPR-23PS' inputs may be configured as either 2-Wire (Form A) or 3-Wire (Form C). Selector Jumper J1 selects the configuration for INPUT #1. Selector Jumper J2 sets the configuration for INPUT #2. Place the Jumper Plug in the correct position for the input type desired: Bottom-to-middle pin for Form A (2-Wire), or middle-to-top pin for Form C (3-Wire).

FUSES - The fuses are type 3AG and may be up to 1/2 Amp in size. Three 1/2 Amp fuses (F1-F3) are supplied standard with the unit unless otherwise specified.


OUTPUTS - Three 3-wire isolated outputs are provided on the RPR-23PS, with output terminals K1, Y1 & Z1; K2, Y2, & Z2; and K3, Y3 & Z3. Arc suppression for the contacts of the solid-state relays are provided internally. Each relay is assigned to one of the two input channels. Using the selector switch for each relay select "A" for input number 1 or "B" for input number 2. The output will follow the input selected.



SOLID STATE INSTRUMENTS

a division of Brayden Automation Corp.
6230 Aviation Circle, Loveland Colorado 80538
Phone: (970)461-9600 Fax: (970)461-9605
E-mail: support@solidstateinstruments.com

RPR-23PS Wiring Diagram

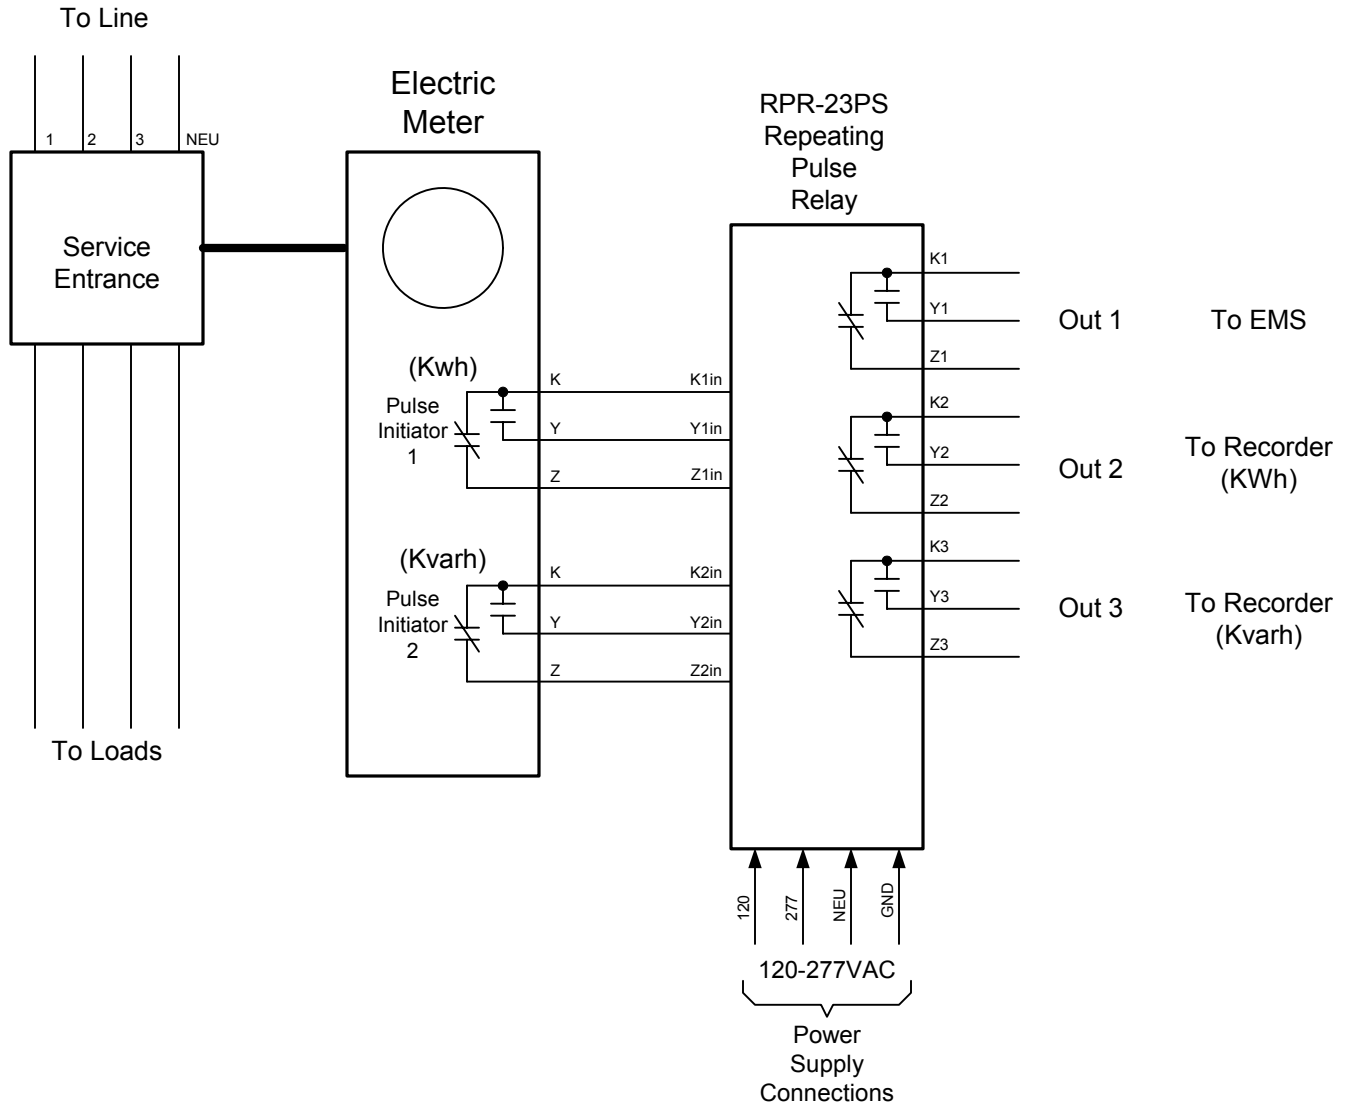

RPR-23PS Repeating Pulse Relay Wiring Diagram		REVISIONS	
		NO.	DATE
DATE ORIGINAL	SCALE		
10/01/08	N/A		
LATEST REVISION	JOB NO.	CHECKED	DRAWN
			WHB

**Brayden Automation Corp./
Solid State Instruments div.**
 6230 Aviation Circle
 Loveland, CO 80538
 (970)461-9600
 (970)461-9205 fax
 www.solidstateinstruments.com