
RPR-903PS

Elite Solid State

PULSE ISOLATION RELAY INSTRUCTION SHEET

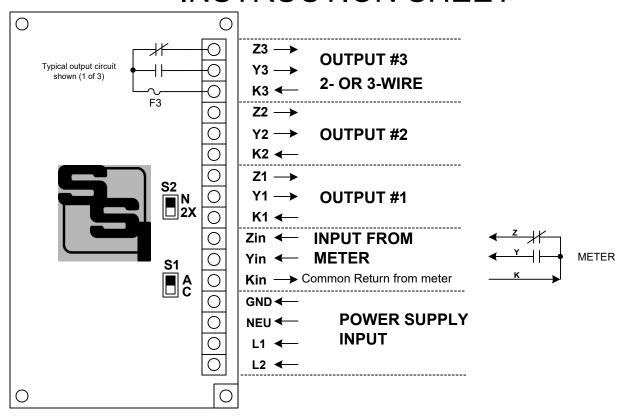

MOUNTING POSITION - The RPR-903PS may be mounted in any position.

POWER INPUT - For a power supply voltage of between 80 and 140 VAC, connecting the hot lead to the L1 terminal and the neutral lead to the NEU terminal. For a power supply voltage of 208 to 277VAC, connect the hot lead to the L2 terminal and the neutral lead to the NEU terminal. Connect the GND lead to the electrical system ground.

METER CONNECTIONS - The RPR-903PS's Kin, Yin and Zin input terminals should be connected to the meter's K, Y and Z terminals: Kin to K, Yin to Y, and Zin to Z. The RPR-903PS's Kin terminal provides the common system return (ground) to the meter's "K" terminal. The Yin and Zin terminals are "pulled up" to the +13VDC wetting voltage. For 2-wire metering system, connect only the Kin and Yin terminals to the meter. Set S1 to A (up) if using a 2-Wire input or to C (down) for a 3-Wire input.

FUSES - The fuses are type 3AG and may be up to $\underline{1/2 \text{ Amp}}$ in size. Three 1/2 Amp fuses (F1, F2 and F3) are supplied standard with the unit unless otherwise specified. Fuses are rated for 250VAC/VDC max.

OUTPUTS - Outputs 1 & 2 are fixed 3-wire outputs. Output #3 may be operated as either a 2-wire (Form A) or 3-wire (Form C) output. For 3-wire("NORMAL") operation, set switch S2 to the N (up) position. For the 2-wire output mode, set S2 to the 2X (down) position and use the "K3" & "Y3" terminals. In the 2-wire mode("Pulse Doubling"), a 100mS fixed-width output pulse occurs for each change of input state. Arc suppression for the contacts of each solid-state relay is provided internally. The RPR-903PS's outputs are rated at 1/ amps at 250VAC/VDC.




SOLID STATE INSTRUMENTS

by Radian Research, Inc 3852 Fortune Dr, Lafayette, IN 47905 Phone: (765) 449-5576

Mail: technicalsupport@radianresearch.com

Revision: 01/01/2025 P/N: 05193-97006A

RPR-903PS Wiring Diagram

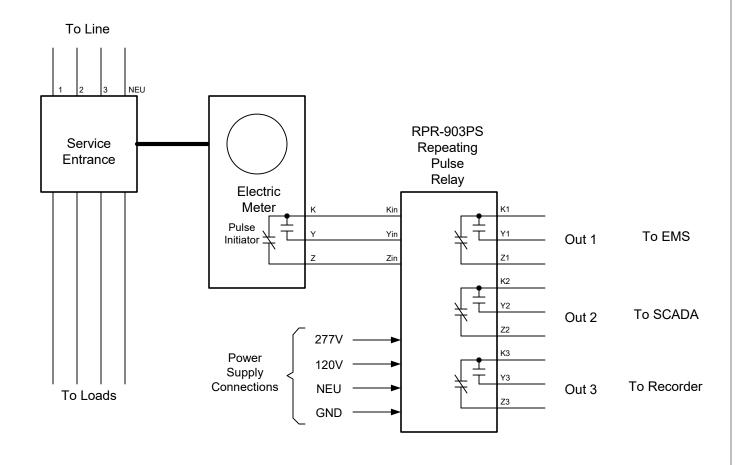

	RPR-903PS Repeating Pulse Relay Wiring Diagram		REVISIONS					
			NO.	DATE	DESCRIPTION			
							Ħ	
	DATE ORIGINAL 01/01/2025	SCALE N/A						
	LATEST REVISION	JOB NO.	CHECKED			WHB		1

Solid State Instruments by Radian Research Inc

3852 Fortune Dr Lafayette, IN 47905 (765) 449-5576 technicalsupport@radi

technicalsupport@radianresearch.com www.solidstateinstruments.com